


CB7017-02 Module Calibration Check

	input Vdc	ch0	%error ch0	ch1	%error ch1	ch2	%error ch2	ch3	%error ch3
Record 0	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000
Record 1	0.1111	0.1111	-0.0120	0.1111	-0.0090	0.1111	-0.0060	0.1111	0.0000
Record 2	0.2222	0.2223	-0.0240	0.2222	-0.0210	0.2223	-0.0240	0.2222	-0.0195
Record 3	0.3333	0.3334	-0.0300	0.3334	-0.0260	0.3334	-0.0290	0.3334	-0.0250
Record 4	0.4444	0.4445	-0.0225	0.4445	-0.0225	0.4445	-0.0225	0.4445	-0.0225
Record 5	0.5555	0.5556	-0.0210	0.5556	-0.0192	0.5556	-0.0204	0.5556	-0.0216
Record 6	0.6666	0.6668	-0.0285	0.6668	-0.0280	0.6668	-0.0285	0.6668	-0.0280
Record 7	0.7777	0.7779	-0.0266	0.7779	-0.0257	0.7779	-0.0257	0.7779	-0.0257
Record 8	0.8888	0.8890	-0.0225	0.8890	-0.0225	0.8890	-0.0225	0.8890	-0.0225
Record 9	0.9999	1.0002	-0.0263	1.0002	-0.0270	1.0002	-0.0253	1.0002	-0.0270
Record 10	1.1111	1.1114	-0.0267	1.1114	-0.0270	1.1114	-0.0264	1.1114	-0.0267
Record 11	2.2222	2.2227	-0.0238	2.2227	-0.0246	2.2227	-0.0243	2.2227	-0.0239
Record 12	3.3333	3.3341	-0.0240	3.3341	-0.0242	3.3341	-0.0241	3.3341	-0.0241
Record 13	4.4444	4.4455	-0.0245	4.4455	-0.0246	4.4455	-0.0245	4.4455	-0.0244
Record 14	4.9555	4.9567	-0.0246	4.9567	-0.0246	4.9567	-0.0243	4.9567	-0.0245
Record 15	-4.9555	-4.9567	-0.0244	-4.9567	-0.0244	-4.9567	-0.0242	-4.9567	-0.0244
Record 16	-4.4444	-4.4455	-0.0247	-4.4455	-0.0247	-4.4455	-0.0248	-4.4455	-0.0248
Record 17	-3.3333	-3.3341	-0.0241	-3.3341	-0.0242	-3.3341	-0.0240	-3.3341	-0.0241
Record 18	-2.2222	-2.2227	-0.0244	-2.2228	-0.0255	-2.2228	-0.0253	-2.2228	-0.0260
Record 19	-1.1111	-1.1114	-0.0270	-1.1114	-0.0270	-1.1114	-0.0270	-1.1114	-0.0267
Record 20	-0.9999	-1.0002	-0.0290	-1.0002	-0.0290	-1.0002	-0.0283	-1.0002	-0.0293
Record 21	-0.8888	-0.8890	-0.0236	-0.8890	-0.0240	-0.8890	-0.0233	-0.8890	-0.0244
Record 22	-0.7777	-0.7779	-0.0257	-0.7779	-0.0257	-0.7779	-0.0261	-0.7779	-0.0257
Record 23	-0.6666	-0.6668	-0.0295	-0.6668	-0.0300	-0.6668	-0.0300	-0.6668	-0.0300
Record 24	-0.5555	-0.5557	-0.0288	-0.5557	-0.0300	-0.5557	-0.0288	-0.5557	-0.0312
Record 25	-0.4444	-0.4446	-0.0345	-0.4446	-0.0375	-0.4446	-0.0390	-0.4446	-0.0353
Record 26	-0.3333	-0.3334	-0.0300	-0.3334	-0.0290	-0.3334	-0.0300	-0.3334	-0.0300
Record 27	-0.2222	-0.2223	-0.0450	-0.2223	-0.0435	-0.2223	-0.0420	-0.2223	-0.0420
Record 28	-0.1111	-0.1111	-0.0180	-0.1111	-0.0210	-0.1111	-0.0330	-0.1111	-0.0240
Record 29	-0.0111	-0.0111	0.0000	-0.0111	0.0000	-0.0111	-0.0601	-0.0111	0.0000
Record 30	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000

CB7017-02 Module Calibration Check

	ch4	%error ch4	ch5	%error ch5	ch6	%error ch6	ch7	%error ch7
Record 0	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000
Record 1	0.1111	-0.0030	0.1111	-0.0030	0.1111	-0.0060	0.1111	-0.0030
Record 2	0.2222	-0.0195	0.2223	-0.0255	0.2223	-0.0225	0.2223	-0.0240
Record 3	0.3334	-0.0280	0.3334	-0.0280	0.3334	-0.0260	0.3334	-0.0270
Record 4	0.4445	-0.0225	0.4445	-0.0225	0.4445	-0.0225	0.4445	-0.0225
Record 5	0.5556	-0.0192	0.5556	-0.0210	0.5556	-0.0198	0.5556	-0.0186
Record 6	0.6668	-0.0260	0.6668	-0.0290	0.6668	-0.0280	0.6668	-0.0270
Record 7	0.7779	-0.0257	0.7779	-0.0261	0.7779	-0.0270	0.7779	-0.0257
Record 8	0.8890	-0.0225	0.8890	-0.0225	0.8890	-0.0229	0.8890	-0.0225
Record 9	1.0002	-0.0260	1.0001	-0.0227	1.0002	-0.0267	1.0002	-0.0260
Record 10	1.1114	-0.0270	1.1114	-0.0267	1.1114	-0.0264	1.1114	-0.0258
Record 11	2.2228	-0.0249	2.2227	-0.0234	2.2227	-0.0239	2.2227	-0.0242
Record 12	3.3341	-0.0240	3.3341	-0.0240	3.3341	-0.0240	3.3341	-0.0240
Record 13	4.4455	-0.0246	4.4455	-0.0246	4.4455	-0.0247	4.4455	-0.0245
Record 14	4.9567	-0.0243	4.9567	-0.0243	4.9567	-0.0244	4.9567	-0.0247
Record 15	-4.9567	-0.0244	-4.9567	-0.0244	-4.9567	-0.0245	-4.9567	-0.0246
Record 16	-4.4455	-0.0246	-4.4455	-0.0248	-4.4455	-0.0247	-4.4455	-0.0248
Record 17	-3.3341	-0.0243	-3.3341	-0.0242	-3.3341	-0.0244	-3.3341	-0.0242
Record 18	-2.2228	-0.0248	-2.2227	-0.0244	-2.2228	-0.0249	-2.2228	-0.0253
Record 19	-1.1114	-0.0270	-1.1114	-0.0270	-1.1114	-0.0270	-1.1114	-0.0270
Record 20	-1.0002	-0.0290	-1.0002	-0.0290	-1.0002	-0.0293	-1.0002	-0.0293
Record 21	-0.8890	-0.0233	-0.8890	-0.0236	-0.8890	-0.0233	-0.8890	-0.0244
Record 22	-0.7779	-0.0266	-0.7779	-0.0257	-0.7779	-0.0257	-0.7779	-0.0257
Record 23	-0.6668	-0.0300	-0.6668	-0.0300	-0.6668	-0.0300	-0.6668	-0.0300
Record 24	-0.5557	-0.0294	-0.5557	-0.0324	-0.5557	-0.0312	-0.5557	-0.0282
Record 25	-0.4446	-0.0390	-0.4446	-0.0353	-0.4446	-0.0390	-0.4446	-0.0383
Record 26	-0.3334	-0.0300	-0.3334	-0.0300	-0.3334	-0.0300	-0.3334	-0.0300
Record 27	-0.2223	-0.0405	-0.2223	-0.0390	-0.2223	-0.0420	-0.2223	-0.0450
Record 28	-0.1111	-0.0150	-0.1111	-0.0180	-0.1111	-0.0330	-0.1111	-0.0270
Record 29	-0.0111	-0.0601	-0.0111	0.0000	-0.0111	0.0000	-0.0111	-0.0300
Record 30	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000	0.0000

CB7017-02

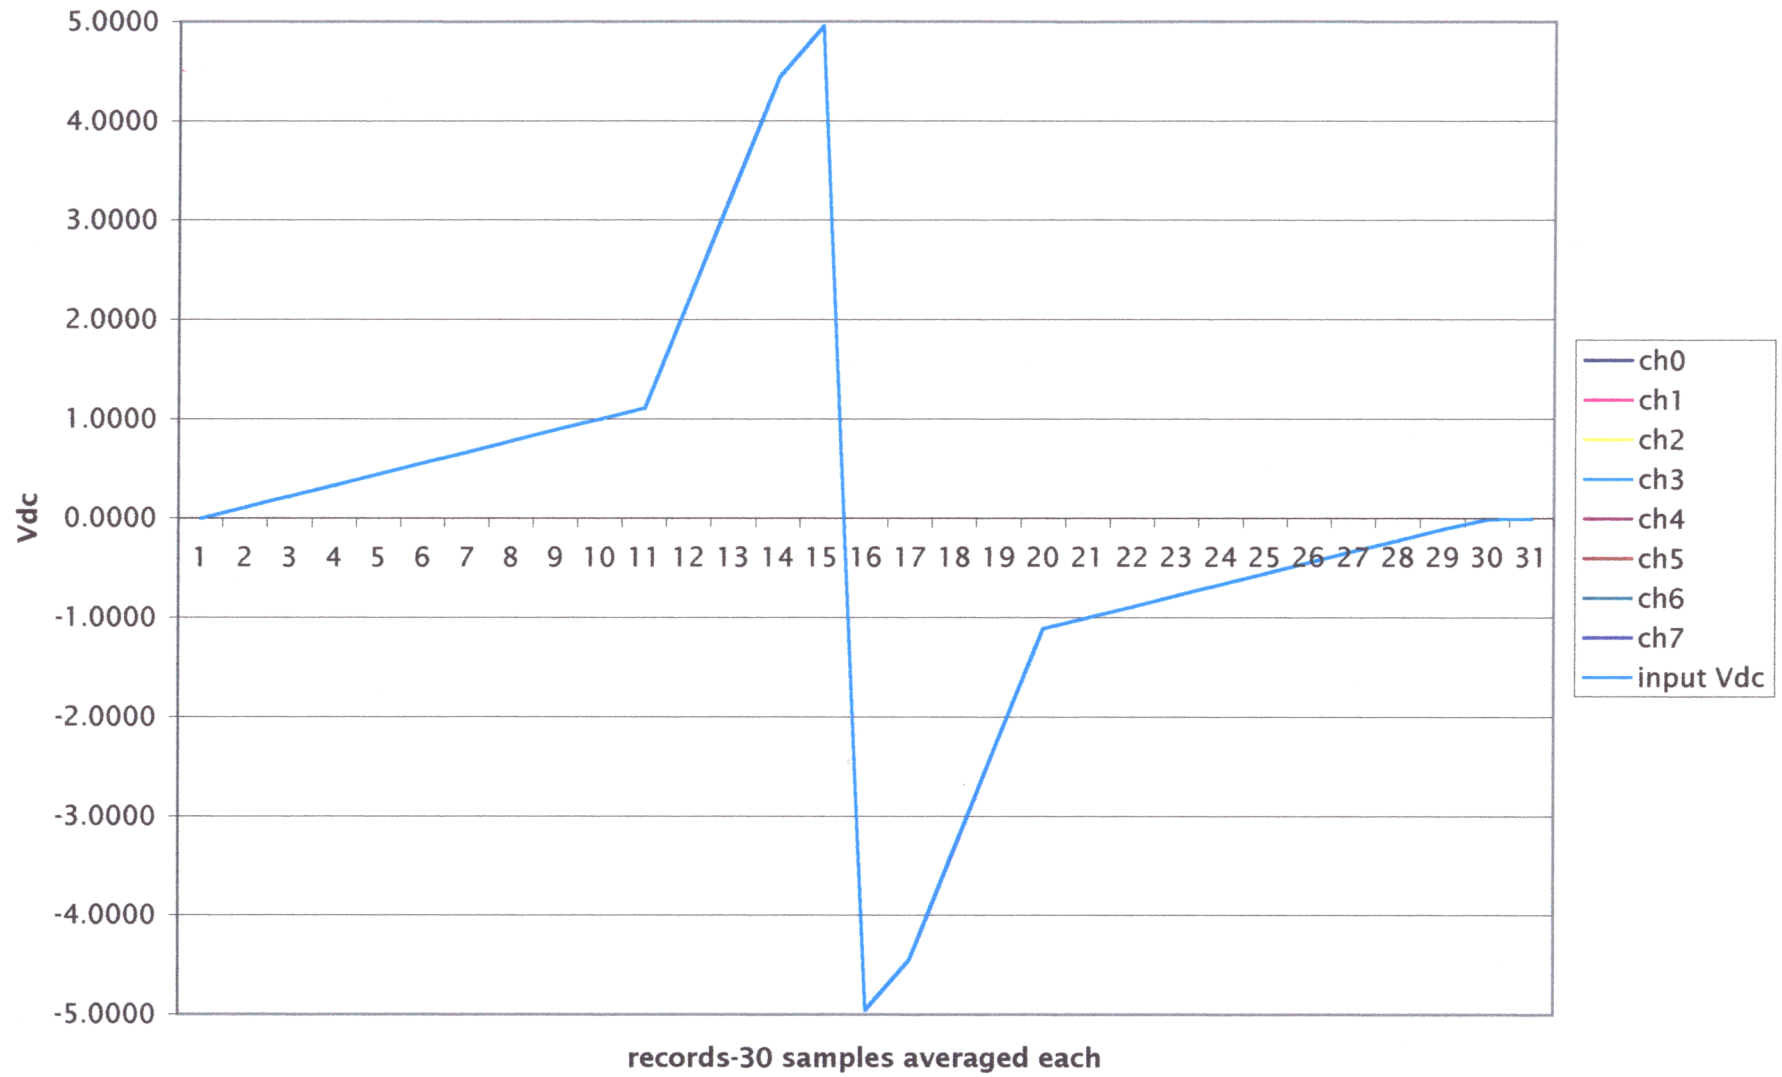

%Relative Error CB7017-02

